


# EJ Water Distribution Zones

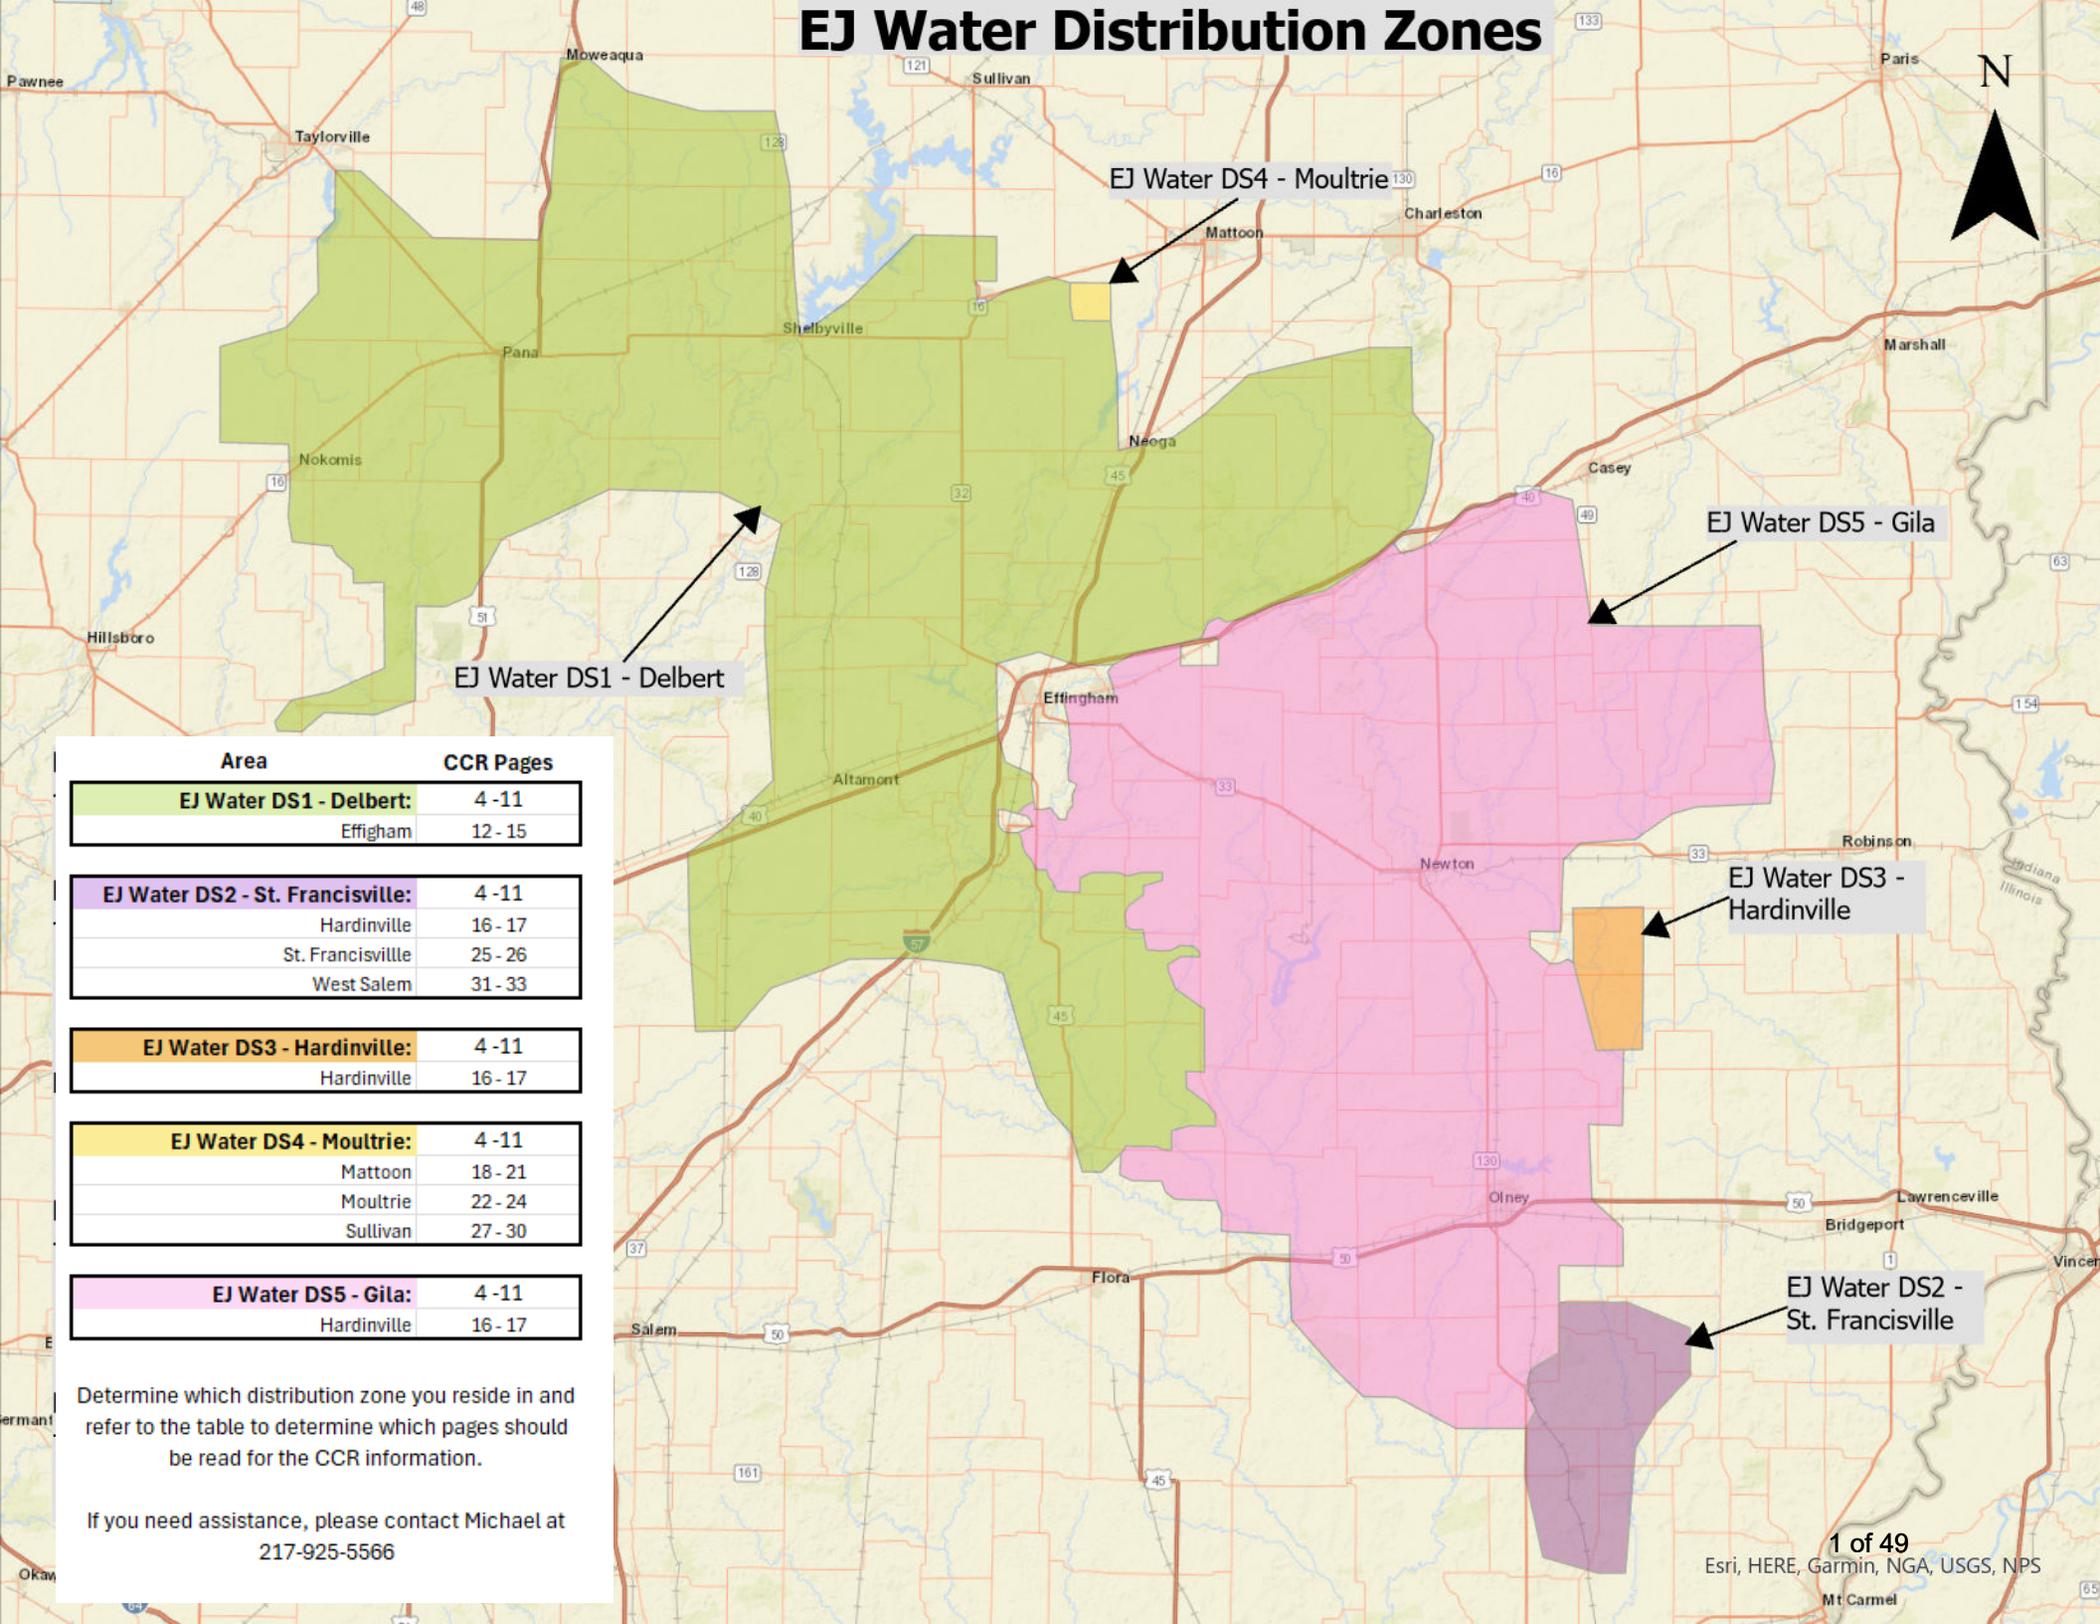


Area	CCR Pages
<b>EJ Water DS1 - Delbert:</b>	4 - 11
Effingham	12 - 15
<b>EJ Water DS2 - St. Francisville:</b>	4 - 11
Hardinville	16 - 17
St. Francisville	25 - 26
West Salem	31 - 33
<b>EJ Water DS3 - Hardinville:</b>	4 - 11
Hardinville	16 - 17
<b>EJ Water DS4 - Moultrie:</b>	4 - 11
Mattoon	18 - 21
Moultrie	22 - 24
Sullivan	27 - 30
<b>EJ Water DS5 - Gila:</b>	4 - 11
Hardinville	16 - 17

Determine which distribution zone you reside in and refer to the table to determine which pages should be read for the CCR information.

If you need assistance, please contact Michael at 217-925-5566

# EJ SangChris Distribution Zones

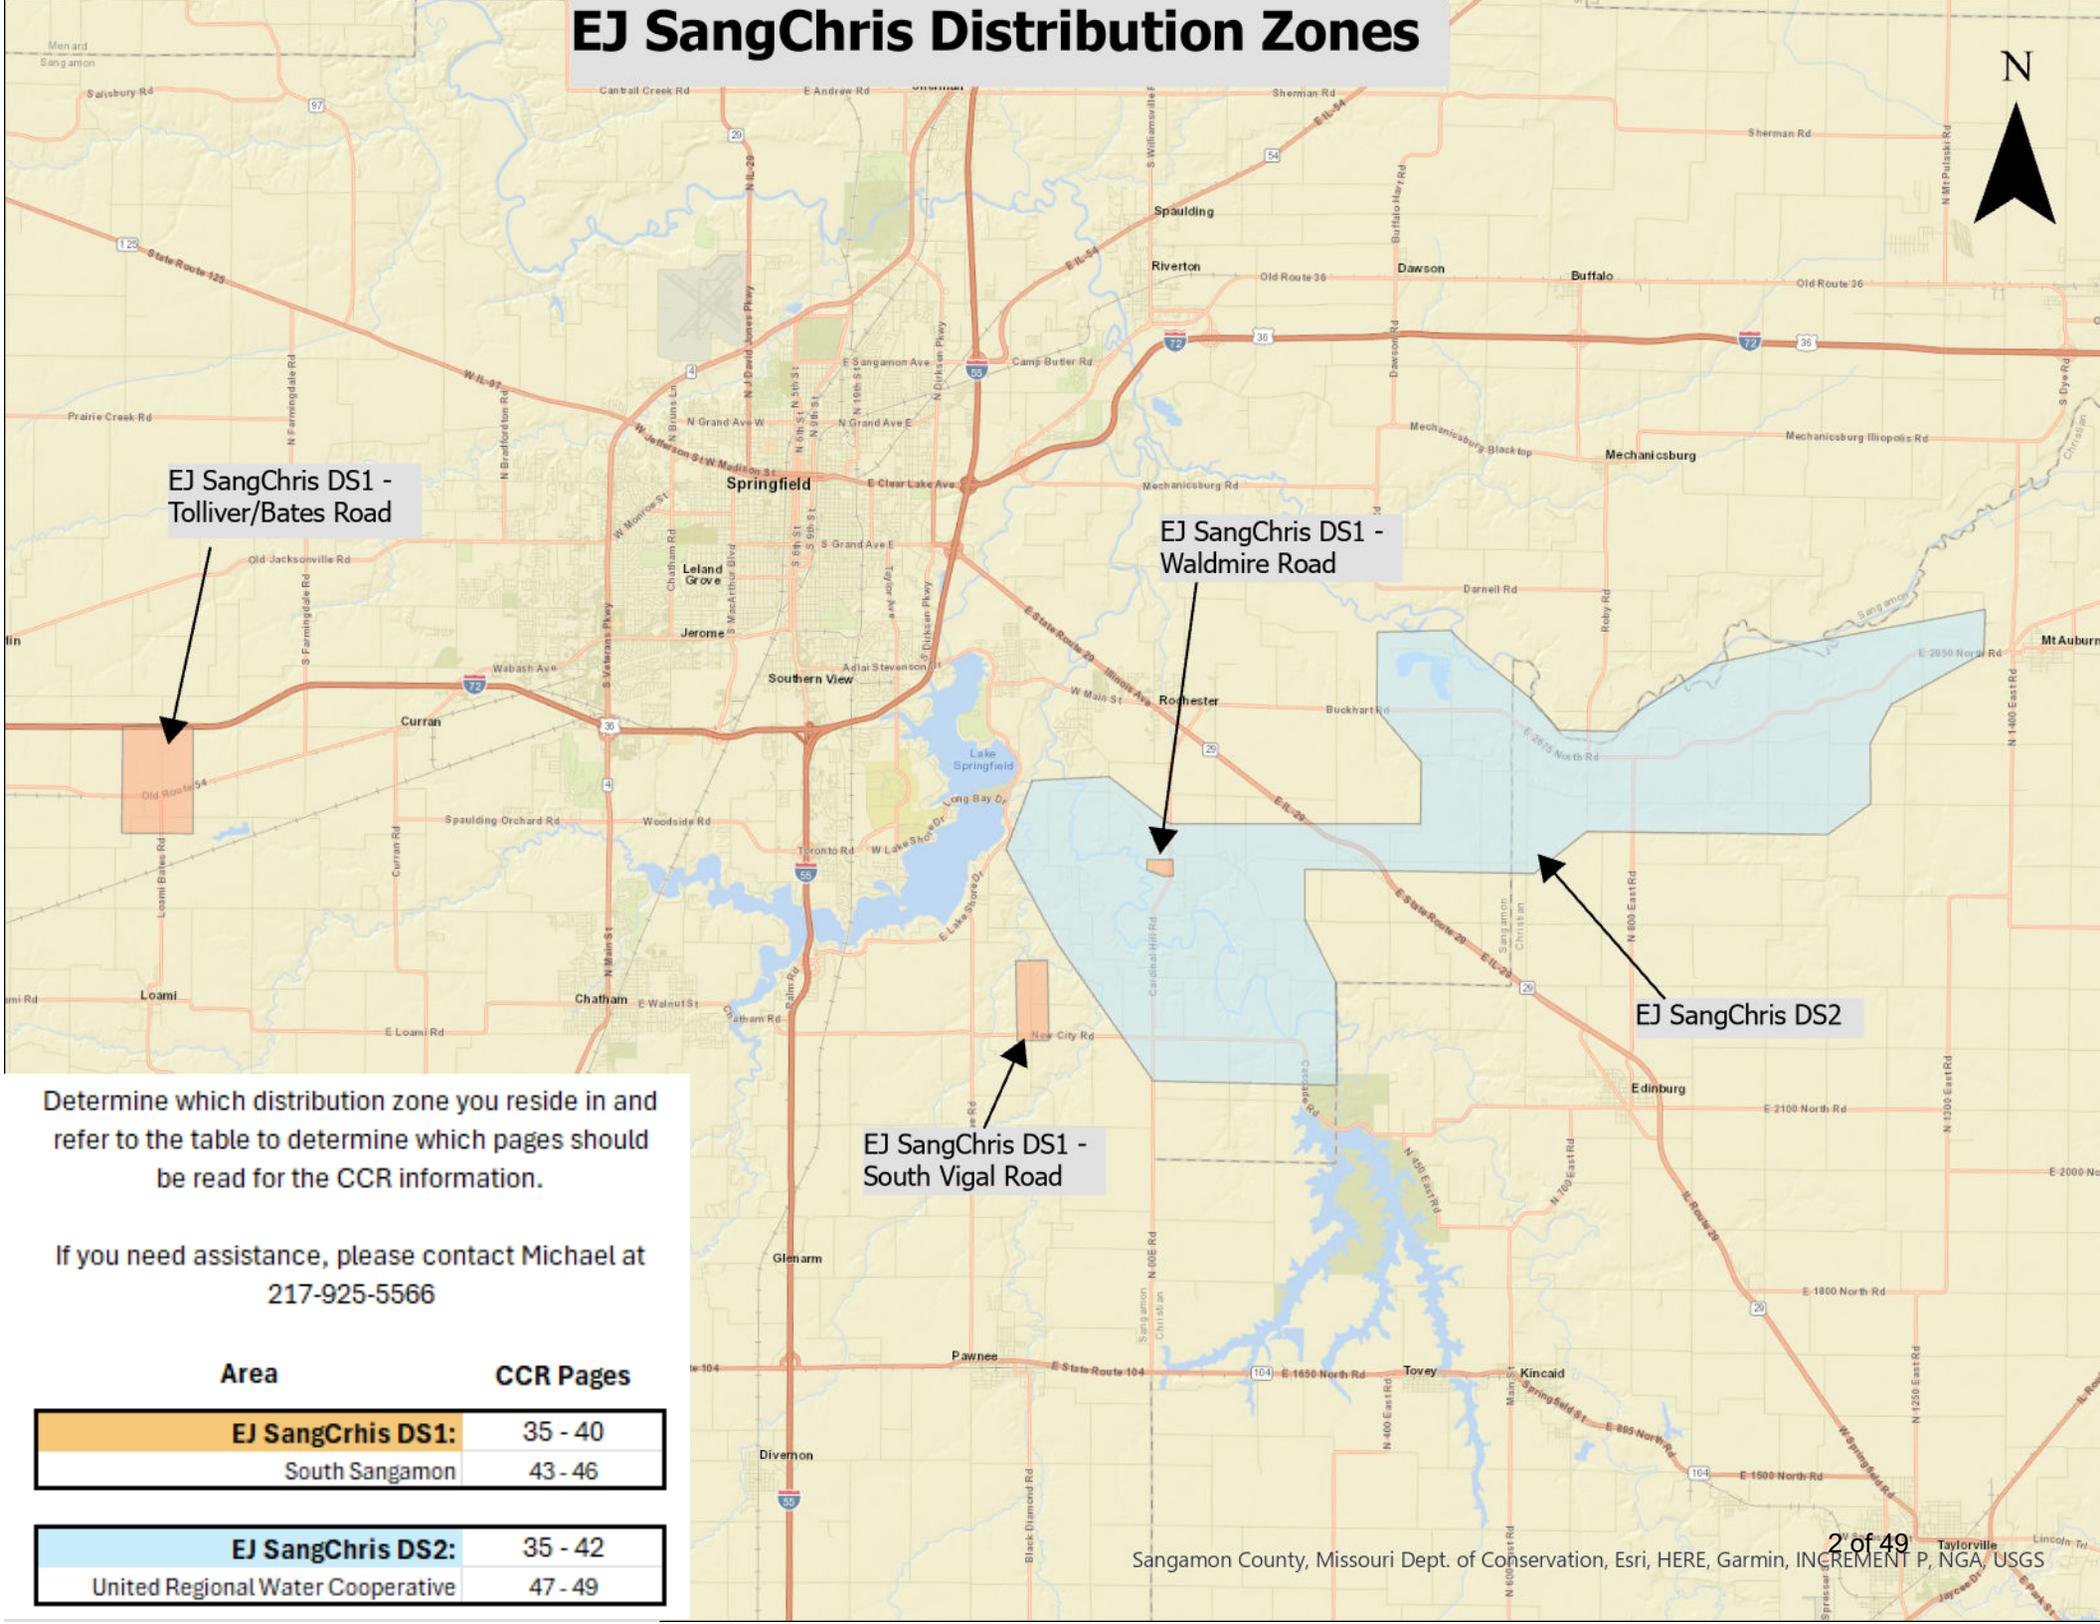

EJ SangChris DS1 - Tolliver/Bates Road

EJ SangChris DS1 - Waldmire Road

EJ SangChris DS2

EJ SangChris DS1 - South Vigal Road

Determine which distribution zone you reside in and refer to the table to determine which pages should be read for the CCR information.

If you need assistance, please contact Michael at 217-925-5566

Area	CCR Pages
<b>EJ SangChris DS1:</b>	35 - 40
South Sangamon	43 - 46
<b>EJ SangChris DS2:</b>	35 - 42
United Regional Water Cooperative	47 - 49

The following pages are the CCR for for EJ Water Cooperative. Each EJ Water member should review pages 4 - 11. Refer to the map page to see which additional sources should be reviewed for each distribution zone.

Area	CCR Pages
<b>EJ Water DS1 - Delbert:</b>	4 -11
Effingham	13 - 16
<b>EJ Water DS2 - St. Francisville:</b>	4 -11
Hardinville	17 - 18
St. Francisville	26 - 27
West Salem	32 - 34
<b>EJ Water DS3 - Hardinville:</b>	4 -11
Hardinville	17 - 18
<b>EJ Water DS4 - Moultrie:</b>	4 -11
Mattoon	19 - 22
Moultrie	23 - 25
Sullivan	28 -31
<b>EJ Water DS5 - Gila:</b>	4 -11
Hardinville	17 - 18

# Consumer Confidence Report

## Annual Drinking Water Quality Report

EJ WATER COOPERATIVE

IL0790010

Annual Water Quality Report for the period of January 1 to December 31, 2023

This report is intended to provide you with important information about your drinking water and the efforts made by the water system to provide safe drinking water.

The source of drinking water used by EJ WATER COOPERATIVE is Surface Water

For more information regarding this report contact:

Name           i hael  osbis h          

Phone           217-925-5566          

Este informe contiene información muy importante sobre el agua que usted bebe. Tradúzcalo ó hable con alguien que lo entienda bien.

Source of Drinking Water
The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.
Contaminants that may be present in source water include: - Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.  - Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.  - Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.  - Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.  - Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPAs Safe Drinking Water Hotline at (800) 426-4791.
In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.
Some people may be more vulnerable to contaminants in drinking water than the general population.
Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).
If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <a href="http://www.epa.gov/safewater/lead">http://www.epa.gov/safewater/lead</a> .

Source Water Information

Source Water Name	Type of Water	Report Status	Location
CC03 - EJ SOUTH EFFINGHAM MASTER FF IL0490250 TP01 TO DS5	SW	_____	_____
CC04 - EJ HARDINVILLE WC CONNECTIONFF IL0330020 TP02, FLOWS	GW	_____	_____
CC06 - EJ S. LAWRENCE WC MASTER	GW	_____	_____
CC08 - EJ NORTH EFFINGHAM MASTER FF IL0490250 TP01 TO DS5	SW	_____	Approximately 773 feet west of the intersection of Interstate 57 and County Rd. 1600 E, Effingham
CC09 - EJ HARDINVILLE WC CONNECTIONFF IL0330020, TP02, FLOWS	GW	_____	Intersection of County Rd. 2300 E and 650 N, Oblong zip code, Jasper/Crawford County line.
CC10 - EJ MOULTRIE CO. RWD MASTER FF1395150 CC04	SW	_____	Northeast corner of the intersection of County Rd. 1500 N and County Rd. 3405 E, Gays zip code, Shelby County.
IN01895 - HOLLAND ENERGY RESRVR	SW	_____	_____
IN01952 - KASKASKIA RIVER INTAKE KASKASKIA RIVER	SW	_____	_____
WELL 1 (WL00807) NORTH WELLFIELD. DRILLED	GW	_____	Located approximately 1.23 miles northeast of the intersection of E. 1650th Ave. and N. 800th St., Newton zip code.
WELL 11 (WL01123) DRILLED 9/30/1996.	GW	_____	Located approximately 2,200 feet west of the intersection of N. 925th St. and E. 1475th Ave., Newton zip code.
WELL 12 (WL01237) DRILLED 7/28/1997, SOUTH	GW	_____	Located approximately 2,200 feet west of the intersection of N. 925th St. and E. 1475th Ave., Newton zip code.
WELL 13 (WL01353) DRILLED JUNE 2000, SOUTH	GW	_____	Located approximately 2,200 feet west of the intersection of N. 925th St. and E. 1475th Ave., Newton zip code.
WELL 14 (WL01354) DRILLED JUNE 2000, SOUTH	GW	_____	_____
WELL 2 (WL00808) NORTH WELLFIELD. DRILLED	GW	_____	Located approximately 1.23 miles northeast of the intersection of E. 1650th Ave. and N. 800th St., Newton zip code.
WELL 20 (WL02005) WELLFIELD JUST SOUTH OF	GW	_____	Approximately 1.35 miles east of the intersection of E. 180th Ave. and N. 800th St. Zip code is for Hidalgo, IL.
WELL 21 (WL02006) WELLFIELD JUST SOUTH OF	GW	_____	Approximately 1.35 miles east of the intersection of E. 180th Ave. and N. 800th St. Zip code is for Hidalgo, IL.
WELL 22 (WL02007) WELLFIELD JUST SOUTH OF	GW	_____	Approximately 1.35 miles east of the intersection of E. 180th Ave. and N. 800th St. Zip code is for Hidalgo, IL.
WELL 4 (WL01764) NORTH WELLFIELD, DRILLED	GW	_____	Located approximately 1.23 miles northeast of the intersection of E. 1650th Ave. and N. 800th St., Newton zip code.
WELL 5 (WL01843) NORTH WELLFIELD, DRILLED	GW	_____	Located approximately 1.23 miles northeast of the intersection of E. 1650th Ave. and N. 800th St., Newton zip code.

## Source Water Assessment

We want our valued customers to be informed about their water quality. If you would like to learn more, please feel welcome to attend any of our regularly scheduled meetings. The source water assessment for our supply has been completed by the Illinois EPA. If you would like a copy of this information, please stop by City Hall or call our water operator at 217-925-5566. To view a summary version of the completed Source Water Assessments, including: Importance of Source Water; Susceptibility to Contamination Determination; and documentation/recommendation of Source Water Protection Efforts, you may access the Illinois EPA website at <http://www.epa.state.il.us/cgi-bin/wp/swap-fact-sheets.pl>.

Source of Water: E J WATER COOPERATIVE To determine E J Water Corporation's susceptibility to groundwater contamination, the Illinois EPA reviewed a Well Site Survey, published in 1996 by the Illinois EPA, a Source Water Protection Management Plan, prepared by the facility's planning committee and published in 1997, and a survey of the south well field performed in 2005. Based on the above documents, the community water supply's source water is susceptible to IOC and SOC contamination from non-point sources related to agricultural land use, although no presence of any pesticides/herbicides were detected in any water samples thus far analyzed. As a result of monitoring conducted at the wells and entry point to the distribution system, the land use activities, and source water protection initiatives by the facility, the E J Water Corporation's groundwater source is not susceptible to VOC contamination. However, Illinois EPA considers all surface water sources of public water supply to be susceptible to potential pollution problems. Hence the reason for mandatory treatment of all public water supplies in Illinois. Mandatory treatment includes coagulation, sedimentation, filtration and disinfection. Source of Water: HARDINVILLE WATER COMPANY To determine Hardinville Water Company's susceptibility to groundwater contamination, the 2007 survey was reviewed. No potential sources, routes, or possible problem sites exist within the 400 foot minimum setback zones, 1,000 foot maximum setback zone, or the 5-year recharge area. No sites are located within either setback zone or recharge area. The Illinois EPA considers the source water of this facility to be susceptible to SOC contamination. This determination is based on a number of criteria including: monitoring conducted at the wells, monitoring conducted at the entry point to the distribution system, the available hydrogeologic data on the wells, and the land-use activities in the recharge area of the wells. Source of Water: EFFINGHAM Illinois EPA considers all surface water sources of public water supply to be susceptible to potential pollution problems. Hence the reason for mandatory treatment of all public water supplies in Illinois. Mandatory treatment includes coagulation, sedimentation, filtration and disinfection. Primary sources of pollution in Illinois lakes can include agricultural runoff, land disposal (septic systems) and shoreline erosion. Source of Water: ST. FRANCISVILLE To determine St. Francisville's susceptibility to groundwater contamination, the source water protection areas were surveyed by the Illinois Rural Water Association in 2002. During this survey, no potential sources, routes, or possible problem sites were located within the 400 foot minimum setback zone of wells #6, #7 and #8. Additionally, no potential sources or problem sites were located within the potential 1,000 foot maximum setback zone of the wells. Furthermore, no potential sources, routes, or possible problem sites were encountered within St. Francisville's recharge areas. The Illinois EPA has determined that St. Francisville's wells #6, #7 and #8 are susceptible to SOC contamination. This determination is based on a number of criteria including: monitoring conducted at the wells, monitoring conducted at the entry point to the distribution system, and the available hydrogeologic data on the wells.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.185	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2023	0	15	4.2	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

## Water Quality Test Results

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	2	0 - 2	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Chlorite	2023	0.95	0.23 - 0.95	0.8	1	ppm	N	By-product of drinking water disinfection.
Haloacetic Acids (HAA5)	2023	26	1.33 - 36.2	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	57	10.64 - 56.9	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Barium	2023	0.0045	0.0022 - 0.0045	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	2023	0.6	0.555 - 0.613	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Manganese	2023	6.4	0 - 6.4	150	150	ppb	N	This contaminant is not currently regulated by the USEPA. However, the state regulates. Erosion of natural deposits.
Nitrate [measured as Nitrogen]	2023	0.25	0.19 - 0.25	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Selenium	2023	1.2	0 - 1.2	50	50	ppb	N	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines.
Sodium	2023	11	11 - 16			ppm	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Combined Radium 226/228	07/07/2021	0.189	0.189 - 0.189	0	5	pCi/L	N	Erosion of natural deposits.
Synthetic organic contaminants including pesticides and herbicides	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination

Simazine	2023	0.37	0 - 0.37	4	4	ppb	N	Herbicide runoff.
----------	------	------	----------	---	---	-----	---	-------------------

**Turbidity**

	Limit (Treatment Technique)	Level Detected	Violation	Likely Source of Contamination
Highest single measurement	1 NTU	0.223 NTU	N	Soil runoff.
Lowest monthly % meeting limit	0.3 NTU	100%	N	Soil runoff.

Information Statement: Turbidity is a measurement of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration system and disinfectants.

**Total Organic Carbon**

The percentage of Total Organic Carbon (TOC) removal was measured each month and the system met all TOC removal requirements set, unless a TOC violation is noted in the violations section.

---

## **Special Notice for Availability of Unregulated Contaminant Monitoring Data**

### **IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER**

#### **Availability of Monitoring Data for Unregulated Contaminants for EJ Water Cooperative**

Our water system has sampled for a series of unregulated contaminants. Unregulated contaminants are those that don't yet have a drinking water standard set by EPA. The purpose of monitoring for these contaminants is to help EPA decide whether the contaminants should have a standard. As our customers, you have a right to know that this data is available. If you are interested in examining the results, please contact Michael Nosbisch at 217-925-5566 or 108 S Main St, Dieterich, IL 62424.

This notice is being sent to you by EJ Water Cooperative. State Water System ID#: IL0790010

Date distributed: 3/25/24.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.057	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2023	0	15	1.2	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

## Water Quality Test Results

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

## Regulated Contaminants

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chloramines	2023	2.1	0 - 2.3	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	35	17 - 31	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	50	24.1 - 48.6	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Barium	2023	0.014	0.014 - 0.014	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	2023	0.6	0.597 - 0.597	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2023	0.19	0.19 - 0.19	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Sodium	2023	22	22 - 22			ppm	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Synthetic organic contaminants including pesticides and herbicides	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Simazine	2023	1	0 - 0.55	4	4	ppb	N	Herbicide runoff.

## Turbidity

	Limit (Treatment Technique)	Level Detected	Violation	Likely Source of Contamination
Highest single measurement	1 NTU	0.19 NTU	N	Soil runoff.
Lowest monthly % meeting limit	0.3 NTU	100%	N	Soil runoff.

Information Statement: Turbidity is a measurement of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration system and disinfectants.

## Effingham

## Total Organic Carbon

The percentage of Total Organic Carbon (TOC) removal was measured each month and the system met all TOC removal requirements set, unless a TOC violation is noted in the violations section.

---

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	08/19/2021	1.3	1.3	0.331	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

ar inville

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	1.4	1.2 - 1.65	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	7	6.9 - 6.9	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	22	22 - 22	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Barium	04/26/2021	0.0198	0.0198 - 0.0198	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	04/26/2021	0.5	0.5 - 0.5	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2023	1	0.94 - 0.94	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Sodium	04/26/2021	8610	8610 - 8610			ppb	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Combined Radium 226/228	07/12/2021	0.87	0.87 - 0.87	0	5	pCi/L	N	Erosion of natural deposits.
Gross alpha excluding radon and uranium	07/12/2021	0.78	0.78 - 0.78	0	15	pCi/L	N	Erosion of natural deposits.

ar inville

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.061	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

## Regulated Contaminants

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chloramines	2023	2.2	2 - 3	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	25	8.62 - 34.5	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	29	1.248 - 39.6	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Barium	2023	0.0089	0.0089 - 0.0089	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	2023	0.7	0.664 - 0.664	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2023	4	0 - 3.7	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Sodium	2023	9	8.9 - 8.9			ppb	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Synthetic organic contaminants including pesticides and herbicides	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Atrazine	2023	0.65	0 - 0.65	3	3	ppb	N	Runoff from herbicide used on row crops.

## Turbidity

	Limit (Treatment Technique)	Level Detected	Violation	Likely Source of Contamination
Highest single measurement	1 NTU	0.29 NTU	N	Soil runoff.
Lowest monthly % meeting limit	0.3 NTU	100%	N	Soil runoff.

Information Statement: Turbidity is a measurement of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration system and disinfectants.

## Mattoon

## Total Organic Carbon

The percentage of Total Organic Carbon (TOC) removal was measured each month and the system met all TOC removal requirements set, unless a TOC violation is noted in the violations section.

---

**Violations Table**

<b>Toxaphene</b>			
Some people who drink water containing toxaphene in excess of the MCL over many years could have problems with their kidneys, liver, or thyroid, and may have an increased risk of getting cancer.			
<b>Violation Type</b>	<b>Violation Begin</b>	<b>Violation End</b>	<b>Violation Explanation</b>
MONITORING, ROUTINE MAJOR	04/01/2023	06/30/2023	We failed to test our drinking water for the contaminant and period indicated. Because of this failure, we cannot be sure of the quality of our drinking water during the period indicated.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	09/21/2022	1.3	1.3	0.45	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	09/21/2022	0	15	2.2	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

**Water Quality Test Results**

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.  
Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	2.2	2.2 - 2.2	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	26	4.1 - 30	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	64	2.9 - 64.2	No goal for the total	80	ppb	N	By-product of drinking water disinfection.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.123	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	1.4	0.65 - 2.02	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Total Trihalomethanes (TTHM)	2023	1	1 - 1	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Arsenic	03/15/2022	0.53	0.53 - 0.53	0	10	ppb	N	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes.
Barium	03/15/2022	0.0249	0.0249 - 0.0249	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	03/15/2022	0.81	0.81 - 0.81	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Manganese	03/15/2022	19	19 - 19	150	150	ppb	N	This contaminant is not currently regulated by the USEPA. However, the state regulates. Erosion of natural deposits.
Nitrate [measured as Nitrogen]	2023	4	2.6 - 4.13	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Sodium	03/15/2022	17100	17100 - 17100			ppb	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Combined Radium 226/228	02/13/2018	1.37	1.37 - 1.37	0	5	pCi/L	N	Erosion of natural deposits.
Gross alpha excluding radon and uranium	02/13/2018	2.1	2.1 - 2.1	0	15	pCi/L	N	Erosion of natural deposits.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	07/08/2020	1.3	1.3	0.36	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	07/08/2020	0	15	2	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

## Water Quality Test Results

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	1.6	0 - 2	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	20	16 - 20.35	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	33	11.24 - 32.8	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Barium	07/14/2021	0.004	0.004 - 0.004	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	07/14/2021	0.651	0.651 - 0.651	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2023	0.05	0.05 - 0.05	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Selenium	07/14/2021	1.5	1.5 - 1.5	50	50	ppb	N	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines.
Sodium	07/14/2021	53	53 - 53			ppb	N	Erosion from naturally occurring deposits. Used in water softener regeneration.

**Violations Table**

<b>Lead and Copper Rule</b>			
The Lead and Copper Rule protects public health by minimizing lead and copper levels in drinking water, primarily by reducing water corrosivity. Lead and copper enter drinking water mainly from corrosion of lead and copper containing plumbing materials.			
<b>Violation Type</b>	<b>Violation Begin</b>	<b>Violation End</b>	<b>Violation Explanation</b>
FOLLOW-UP OR ROUTINE TAP M/R (LCR)	10/01/2023	2023	We failed to test our drinking water for the contaminant and period indicated. Because of this failure, we cannot be sure of the quality of our drinking water during the period indicated.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	1.3	1.01 - 1.44	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	8	8.2 - 8.2	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	27	26.6 - 26.6	No goal for the total	80	ppb	N	By-product of drinking water disinfection.

West ale

**Violations Table**

<b>Lead and Copper Rule</b>			
The Lead and Copper Rule protects public health by minimizing lead and copper levels in drinking water, primarily by reducing water corrosivity. Lead and copper enter drinking water mainly from corrosion of lead and copper containing plumbing materials.			
<b>Violation Type</b>	<b>Violation Begin</b>	<b>Violation End</b>	<b>Violation Explanation</b>
LEAD CONSUMER NOTICE (LCR)	12/30/2022	01/03/2023	We failed to provide the results of lead tap water monitoring to the consumers at the location water was tested. These were supposed to be provided no later than 30 days after learning the results.

The following pages are the CCR for for EJ Water - SangChris.

Each SangChris member should review pages 35 - 42. Please note, the violation described in pages 41 and 42 pertain to DS2.

Refer to the map page to see which additional sources should be reviewed for each distribution zone.

Determine which distribution zone you reside in and refer to the table to determine which pages should be read for the CCR information.

If you need assistance, please contact Michael at 217-925-5566

Area	CCR Pages
<b>EJ SangChris DS1:</b>	35 - 40
South Sangamon	43 - 46
<b>EJ SangChris DS2:</b>	35 - 42
United Regional Water Cooperative	47 - 49

# Consumer Confidence Report

## Annual Drinking Water Quality Report

EJ WATER-SANGCHRIS

IL1670230

Annual Water Quality Report for the period of January 1 to December 31, 2023

This report is intended to provide you with important information about your drinking water and the efforts made by the water system to provide safe drinking water.

The source of drinking water used by EJ WATER-SANGCHRIS is Purchased Ground Water

For more information regarding this report contact:

Name ihael osbis h

Phone 1

Este informe contiene información muy importante sobre el agua que usted bebe. Tradúzcalo ó hable con alguien que lo entienda bien.

Source of Drinking Water
The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.
Contaminants that may be present in source water include: <ul style="list-style-type: none"><li>- Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.</li><li>- Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.</li><li>- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.</li><li>- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.</li><li>- Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.</li></ul>

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPAs Safe Drinking Water Hotline at (800) 426-4791.
In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.
Some people may be more vulnerable to contaminants in drinking water than the general population.
Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).
If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <a href="http://www.epa.gov/safewater/lead">http://www.epa.gov/safewater/lead</a> .

EJ Water angChris

Source Water Information

Source Water Name	Type of Water	Report Status	Location
CC04 - SANGCHRIS AREA (VIGAL RD)	GW	_____	_____
CC05 - NEW BERLIN AREA (LOAMI RD)	GW	_____	_____
CC06-NEW BERLIN AREA (TOLLIVER RD)	GW	_____	_____
CC07 - MASTER METER URWC                      FF 1670260	GW	_____	_____

## Source Water Assessment

We want our valued customers to be informed about their water quality. If you would like to learn more, please feel welcome to attend any of our regularly scheduled meetings. The source water assessment for our supply has been completed by the Illinois EPA. If you would like a copy of this information, please stop by City Hall or call our water operator at 217-925-5566. To view a summary version of the completed Source Water Assessments, including: Importance of Source Water; Susceptibility to Contamination Determination; and documentation/recommendation of Source Water Protection Efforts, you may access the Illinois EPA website at <http://www.epa.state.il.us/cgi-bin/wp/swap-fact-sheets.pl>.

Source of Water: SOUTH SANGAMON WATER COMMISSIONBased on the information located in the Wellhead Protection Planning Map no potential sources are located within the source water protection area of the wells. Information provided by the Leaking Underground Storage Tank and Site Remediation Program Sections of Illinois EPA did not indicate any additional sites with on-going remediation(s). The Illinois EPA has determined that the SSWC's Community Water Supply's source water has a high susceptibility to IOC, SOC, and bacteriological contamination. This determination is based on a number of criteria including: land use near the wells, location within a floodplain, well depth, and the available hydrogeologic data. In accordance with the U.S. EPA's Groundwater Rule, SSWC has received two (2) Non-Compliance Advisory letters (NCA) in 2013 for bacteriological detections in wells #5 and #6. The facility addressed the NCA's in a variety of ways such as chlorinating the well, secured well fittings, new sample tap(s), use of outside environmental consultants and reviewing the sampling protocol. While the NCA(s) have now been resolved, monitoring data is continually being tracked in regards to all active potable wells at SSWC. It should be noted, while the community's wells are properly constructed with sound integrity, the location of the wells is within a floodplain and well depth leaves the potential for bacteriological contamination. However, to date, all potential routes and sanitary defects have been mitigated such that the source water is adequately protected, monitoring data has not indicated a history of disease outbreak and the sanitary survey of the water supply did not indicate a bacteriological contamination threat within 1,000 ft of the source water.

**Coliform Bacteria**

Maximum Contaminant Level Goal	Total Coliform Maximum Contaminant Level	Highest No. of Positive	Fecal Coliform or E. Coli Maximum Contaminant Level	Total No. of Positive E. Coli or Fecal Coliform Samples	Violation	Likely Source of Contamination
0	1 positive monthly sample.	1		0	N	Naturally present in the environment.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.27	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2023	0	15	0.9	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

## Water Quality Test Results

Maximum residual disinfectant level or MRDL:	The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
Maximum residual disinfectant level goal or MRDLG:	The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
na:	not applicable.
mrem:	millirems per year (a measure of radiation absorbed by the body)
ppb:	micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.
ppm:	milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.
Treatment Technique or TT:	A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chloramines	2023	1.5	1 - 1.3	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	22	6 - 24.6	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	111	19.89 - 188.3	No goal for the total	80	ppb	Y	By-product of drinking water disinfection.

**Violations Table**

<b>Lead and Copper Rule</b>		EJ Water SangChris - Distribution 2 service area	
The Lead and Copper Rule protects public health by minimizing lead and copper levels in drinking water, primarily by reducing water corrosivity. Lead and copper enter drinking water mainly from corrosion of lead and copper containing plumbing materials.			
Violation Type	Violation Begin	Violation End	Violation Explanation
FOLLOW-UP OR ROUTINE TAP M/R (LCR)	07/01/2023	09/21/2023	The lead and copper samples were collected and provided to the lab on time. All the results were satisfactory with no detection. However, the lab made an error and did not submit the results on time, resulting in a violation.

<b>Total Trihalomethanes (TTHM)</b>		EJ Water SangChris - Distribution 2 service area	
Some people who drink water containing trihalomethanes in excess of the MCL over many years may experience problems with their liver, kidneys, or central nervous systems, and may have an increased risk of getting cancer.			
Violation Type	Violation Begin	Violation End	Violation Explanation
MCL, LRAA	10/01/2023	12/31/2023	Water samples showed that the amount of this contaminant in our drinking water was above its standard (called a maximum contaminant level and abbreviated MCL) for the period indicated. After receiving the violation, lines were cleaned thoroughly and flushing has continued. Since the violation, the samples have all been below the limit (collected in February and May 2024). Compliance will be achieved once the average of the samples over the past 4 quarters is below the MCL.

**Monitoring Violations Annual Notice Template**

**IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER**

**Monitoring Requirements Not Met for EJ Water – SangChris (DS2) - IL1670230**

Our water system violated several drinking water standards over the past year. Even though these were not emergencies, as our customers, you have a right to know what happened and what we did to correct these situations.

*We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During 4/1/23 – 6/30/23 we collected lead/copper samples as scheduled and submitted them on time. However, there was a lab error in submitting the results, which resulted in a violation of the water system. All samples were satisfactory.*

**What should I do?**

There is nothing you need to do at this time.

The table below lists the contaminant(s) we did not properly test for during the last year, how often we are supposed to sample for lead and copper, how many samples we are supposed to take, how many samples we took, when samples should have been taken, and the date on which follow-up samples were (or will be) taken.

<b>Contaminant</b>	<b>Required sampling frequency</b>	<b>Number of samples taken</b>	<b>When all samples should have been taken</b>	<b>When samples were or will be taken</b>
Lead and Copper	10	10	Quarterly	Quarterly

**What happened? What is being done?**

As stated, this was due to a lab error. We had discussions with the lab regarding their processes.

For more information, please contact Michael at 217-925-5566 or PO Box 8, Dieterich, IL 62424

*Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.*

This notice is being sent to you by [EJ Water - SangChris].      Water System ID#      IL1670230      Date distributed      6/15/24

## 2023 REGULATED CONTAMINANTS DETECTED

### Lead and Copper

Definitions:

Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALG's allow for a margin of safety.

Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90 <sup>th</sup> Percentile	# Sites over AL	Units	Violation	Likely Source of Contaminant
Copper	2023	1.3	1.3	0.9	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; corrosion of household plumbing systems.
Lead	2023	0	15	1.1	0	ppb	N	Corrosion of household pumping systems; Erosion of natural deposits

### Water Quality Test Results

Definitions:

The following tables contain scientific terms and measures, some of which may require explanation.

Level 1 Assessment:

A level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why coliform bacteria have been found in our water system.

Level 2 Assessment:

A level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E.coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

South Sangamon

Maximum Contaminant Level Goal or MCGL	The level of a contaminant in drinking water below which there is no known or expected risk of health. MCLGs allow for a margin of safety.
Maximum Contaminant Level or MCL:	The highest level of a contaminant that is allowed in drinking water. MCL's are set as close to the MCLGs as feasible using the best available treatment technology.
Maximum residual disinfectant level goal or MRDLG	The level of drinking water disinfectant below which there is no known or expected risk of health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
Maximum residual disinfectant level or MRDL:	The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
na:	not applicable.
mrem:	millirem per year (a measure of radiation absorbed by the body).
ppb:	micrograms per liter or parts per billion – or one ounce in 7,350,000 gallons of water.
ppm	milligrams per liter or parts per million – or one ounce in 7,350 gallons of water.
pCi/L	pCi/L; picocuries per liter (a measure of radioactivity)
Treatment Technique or TT:	A required process intended to reduce the level of a contaminant in drinking water.

### Disinfection and Disinfection By-Products

	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chloramines	2023	4.46	1.1 - 4.46	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes
Chlorine	2023	2.90	0 – 2.90	< 4	4	ppm	N	Water additive used to control microbes
Halocetic Acids (HAA5)	5/3/2023	7.23	7.23 – 7.23	No goal for the total	60	ppb	N	By-products of drinking water disinfection.
Total Trihalomethanes (TTHM)	5/3/2023	16.08	16.08 -16.08	No goal for the total	80	ppb	N	By-products of drinking water disinfection.

### Inorganic Contaminants

	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Selenium	8/17/2021	2.3	2.3	<50	50	ppb	N	Erosion of natural deposits.
Barium	8/17/2021	0.015	0.015 – 0.015	2	2	ppm	N	Discharge of drilling wastes; discharge from metal refineries; erosion from natural deposits
Fluoride	8/17/2021	0.731	0.731 – 0.731	4	4.0	ppm	N	Erosion of natural deposits; water additives which promote strong teeth; discharge from fertilizer and aluminum factories.
Iron	2023	.01	.01	None	1.0	ppm	N	This contaminant is not currently regulated by USEPA. However, the state regulates. Erosion of natural deposits.
Manganese	2023	6.2	1 - 6.2	150	150	ppb	N	This contaminant is not currently regulated by USEPA. However, the state regulates. Erosion of natural deposits.
Nitrate (measured as nitrogen)	2023	.5	.5-.5	10	10	ppm	N	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits
Sodium	8/17/2021	170	170-170	None	None	ppm	N	Erosion from naturally occurring deposits: used in water softening regeneration.

**Radioactive Contaminants**

	collection date	highest level detected	Range of Levels Detected	MCLG	MCL	Units	Violations	Likely Source of Contamination
Combined Radium 226/228	8/17/2021	1.686	1.686-1.686	0	5	pCi/L	N	Erosion of Natural Deposits
Gross Alpha excludng radon and Uranium	8/17/2021	5.99	5.99-5.99	0	15	pCi/L	N	Erosion of Natural Deposits

**Violation Table**

Iron – Excessive iron in the water may cause staining of laundry and plumbing fixtures and may accumulate as deposits in the distribution system.

Violation Type	Violation Begin	Violation End	Violation Explanation	Corrective Action
None				

Manganese – Excessive manganese in the water may cause staining of laundry and plumbing fixtures and laundry. It may also produce an unpleasant taste in beverages including coffee.

**Lead and Copper**

Definitions:  
 Action Level Goal (ALG): The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.  
 Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2023	1.3	1.3	0.182	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2023	0	15	9.6	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

**Water Quality Test Results**

Definitions: The following tables contain scientific terms and measures, some of which may require explanation.

Avg: Regulatory compliance with some MCLs are based on running annual average of monthly samples.

Level 1 Assessment: A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Maximum Contaminant Level or MCL: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal or MCLG: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum residual disinfectant level or MRDL: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum residual disinfectant level goal or MRDLG: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

na: not applicable.

mrem: millirems per year (a measure of radiation absorbed by the body)

ppb: micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water.

## Water Quality Test Results

ppm: milligrams per liter or parts per million - or one ounce in 7,350 gallons of water.

Treatment Technique or TT: A required process intended to reduce the level of a contaminant in drinking water.

**Regulated Contaminants**

Disinfectants and Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorine	2023	2	1.5 - 2.42	MRDLG = 4	MRDL = 4	ppm	N	Water additive used to control microbes.
Haloacetic Acids (HAA5)	2023	8	3.3 - 19.62	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2023	26	10.23 - 44.8	No goal for the total	80	ppb	N	By-product of drinking water disinfection.
Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Fluoride	2023	0.4	0.4 - 0.4	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2023	1	0 - 1	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.
Sodium	2023	12400	12400 - 12400			ppm	N	Erosion from naturally occurring deposits. Used in water softener regeneration.
Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Combined Radium 226/228	2023	0.13	0 - 0.13	0	5	pCi/L	N	Erosion of natural deposits.
Gross alpha excluding radon and uranium	2023	2.08	0 - 2.08	0	15	pCi/L	N	Erosion of natural deposits.
Volatile Organic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Xylenes	2023	0.0009	0 - 0.0009	10	10	ppm	N	Discharge from petroleum factories; Discharge from chemical factories.